

November 6, 2025

**School District 70**  
2941 8<sup>th</sup> Avenue  
Port Alberni, BC  
V9Y 3R5

**Attention: Alex Taylor**

**Reference: Potable Water Lead Testing – Eighth Avenue Learning Centre**

---

### ***Introduction***

**Island EHS Ltd** has collected ten (10) water samples from taps at the **Eighth Avenue Learning Centre**, located at 2941 8th Avenue, Port Alberni, BC. The purpose of the sampling is to evaluate potential lead exposure risk from water consumed from the tap. The samples were collected on October 30, 2025, and we report the following.

### ***Sampling Methodology***

Sampling locations were selected by the client. All samples were taken from cold water lines.

The lead samples were collected using the methodology taken from “Guidelines on Evaluating and Mitigating lead in Drinking Water Supplies, Schools, Daycares & Other Buildings” (published April 2019 by the British Columbia Health Protection Branch), using the Random Daytime Sampling method. A 125mL First Draw sample was followed by a 125mL sample taken after a 30-second flush. This methodology was conducted to determine if a 30-second flush is sufficient to reduce the lead concentrations to below the Maximum Acceptable Concentration (MAC).

The samples were collected in an appropriate bottle supplied by an accredited laboratory. The samples were chilled and immediately submitted to the testing laboratory and tested for lead.

Samples were analyzed by the Island EHS in-house laboratory, using procedures based on methods recommended by the American Public Health Association (APHA) and the US Environmental Protection Agency (US-EPA) (EPA 200.9). Our laboratory is accredited by CALA to ISO/IEC 17025:2017 standards. Results were compared to the latest edition of the Canadian Drinking Water Quality Guidelines (CDWQG) published by Health Canada’s Water Quality and Health Bureau.

### Results

Table 1: Lead concentration from tested locations for First Draw and Flushed Sampling, compared to the Maximum Allowable Concentration (MAC) for Lead (0.005 mg/L).

Sample Location	MAC <sup>1</sup> (mg/L)	Random Daytime Sample (mg/L)	Comments
01-S 01-F	0.005	0.0024 0.0008	Kindergarten 113
02-S 02-F	0.005	0.0147 0.0084	Sink Near Corridor 100
03-S 03-F	0.005	0.0057 0.0007	Library Office
04-S 04-F	0.005	0.0010 0.0008	Classroom 141
05-S 05-F	0.005	0.0036 0.0009	Staff Room 106

<sup>1</sup> MAC = Maximum acceptable concentrations  
Results in **RED** indicate values that exceed the CDWQG

Full analytical results can be found in Appendix A.

Locations of the samples can be found in Appendix B.

### Discussion

The building is supplied by the municipal potable water distribution system. According to the BC Health Protection Branch, "Lead is usually not found in drinking water when it leaves the treatment plant. Instead lead tends to leach out of pipes and fixtures in buildings..." Until 1989, the BC Building Code did not have provisions for restricting the use of lead-containing materials in potable water lines. Under the Canadian Standards Association (CSA) B125.1 standard, plumbing, fitting and fixtures produced as recently as 2012 that were considered "lead-free" could contain as much as 8% lead by weight. Since 2012, the maximum percent of lead in fixtures that are considered "lead-free" is 0.25%.

### Conclusions and Recommendations

Of the five (5) locations from which water samples were collected by Island EHS on October 30, 2025, within the Eighth Avenue Learning Centre, located at 2941 8th Avenue, Port Alberni, BC, two (2) location (Sink Near Corridor 100 and Library Office) were found to have lead concentrations which exceeded the maximum acceptable concentration (MAC) in the first draw bottles. One (1) location (Sink Near Corridor 100) was found to have a lead concentration above the MAC after a 30 second flush.

This indicates that there is a source of lead in the pipes and/or fixtures. For the Sink Near Corridor 110 sampling location, which exceeded the maximum acceptable concentration even after a 30-second flush, additional measures should be considered.

**The client may wish to consider the following suggestions to further address lead water service pipes:**

- Replace as much as possible of the plumbing pipes, fixtures and fittings between the water main and the tap itself for the locations that were found to have exceedances, *or*
- Re-testing the two (2) locations which exceeded the maximum acceptable concentration after the 30 second flush after a longer flushing period (i.e., five (5) minutes instead of thirty (30) seconds); *or*

- Disconnect the location which exceeded the maximum acceptable concentration after the 30 second flush, and replace with water cooler units; or
- Where practicable, install in-line filters just before point of use. Ensure the filters are certified to NSF/ANSI 53 for reduction of contaminants that cause health effects. The filters must be changed on a schedule recommended by the manufacturer,
- Employ a flushing program. Run each tap that is used for consumption for at least 30 seconds, or until cold.
- Affix permanent signage directing users to alternate water sources such as water coolers or filtered water, to remind users to adequately flush the lines (“run until cold”) prior to drinking, or to indicate that the water is not potable; and
- Advise occupants to use cold water for cooking and drinking, even after flushing the pipes. Lead in pipes moves more readily into hot water than into cold water.

Following implementation of select recommendations, additional sampling should be conducted at all locations that exceeded the Guideline to ensure that levels are no longer in exceedance. As part of this testing, it is recommended that biannual testing for lead be conducted on sources where potable water is consumed. Following implementation of this recommendation and subsequent results this could be reduced to annual testing from select locations.

### **Limitations**

This report has been prepared in accordance with established Industrial Hygiene practices. It is intended for the exclusive use of School District 70 to assist in the assessment of the drinking water quality in the sampled locations. The use of this document for any other purposes is at the sole risk of the users.

**Island Environmental Health & Safety Ltd.**



Tanner Robinson, HBSc  
Occupational Hygiene Technician  
Field Work and Report



Ashlee McGiffin  
Senior Occupational Hygienist  
Report Review

**Appendix A:  
Analytical Results**

# Lead in Drinking Water Report



Island Environmental Health and Safety  
 201 - 990 Hillside Avenue  
 Victoria B.C, V8T 2A1  
 (778)406-0933  
[admin@islandehs.ca](mailto:admin@islandehs.ca)

## Certificate of Analysis

Client Name	School District 70	Report #	69843
Site Address	Eighth Avenue Learning Centre	Report Date	2025-11-06
Collection Date	2025-10-30	Analysis Date	2025-11-05
Received by Lab	2025-10-31	PO	
Collected By	Tanner/Matt/Sandy	Notes	

### Analysis Summary: Stagnant/Flush

Sample #	EACL01	Result (mg/L)	0.0024	Stagnant
Location	Kindergarten 113	Result (mg/L)	0.0008	Flush
Sampling Time	6:33 AM	Comments		
Sample #	EACL02	Result (mg/L)	0.0147	Stagnant
Location	Sink Near Corridor 100	Result (mg/L)	0.0084	Flush
Sampling Time	6:35 AM	Comments		
Sample #	EACL03	Result (mg/L)	0.0057	Stagnant
Location	Library Office	Result (mg/L)	0.0007	Flush
Sampling Time	6:42 AM	Comments		
Sample #	EACL04	Result (mg/L)	0.0010	Stagnant
Location	Classroom 141	Result (mg/L)	0.0008	Flush
Sampling Time	6:39 AM	Comments		
Sample #	EACL05	Result (mg/L)	0.0036	Stagnant
Location	Staff Room 106	Result (mg/L)	0.0009	Flush
Sampling Time	6:44 AM	Comments		

#### Notes

Results are compared to the latest Canadian Drinking Water Quality Guideline (CDWQG), published by Health Canada

Results in **green** are below the CDWQG limit of 0.005 mg/L

Results in **red** are at or above the CDWQG limit of 0.005 mg/L

Analysed using EPA 200.9



Island  
EHS

Island Environmental Health & Safety Ltd.

# Lead in Drinking Water Report



Island Environmental Health and Safety  
201 - 990 Hillside Avenue  
Victoria B.C, V8T 2A1  
(778)406-0933  
[admin@islandehs.ca](mailto:admin@islandehs.ca)

## Certificate of Analysis

Client Name	School District 70	Report #	69843
Site Address	Eighth Avenue Learning Centre	Report Date	2025-11-06
Collection Date	2025-10-30	Analysis Date	2025-11-05
Received by Lab	2025-10-31	PO	
Collected By	Tanner/Matt/Sandy	Notes	

## Quality Control Report

	Result	Unit	Limits	Pass/Fail?
<b>Duplicate</b>	4	Rel. % Diff	0 - 15 %	<b>PASS</b>
<b>LFM</b>	91	% Recovery	85-115%	<b>PASS</b>
<b>LRB</b>	<0.0005	mg/L	<0.0132 mg/L	<b>PASS</b>
<b>LFB</b>	110	% Recovery	85-115%	<b>PASS</b>

**Duplicate:** Paired analysis of two portions of the same sample. Used to evaluate the variance in the measurement and homogeneity of the sample.

**Laboratory Fortified Matrix (LFM):** A client sample that has been fortified with a known amount of analyte. Used to evaluate matrix effects.

**Laboratory Reagent Blank (LRB):** A blank matrix containing all reagents used in the analytical procedure. Used to identify laboratory contamination.

**Laboratory Fortified Blank (LFB):** A blank matrix to which a known amount of analyte is added. Used to verify instrument calibration.

Results relate only to the items tested

This report is issued by Island EHS,  
accredited by CALA to ISO/IEC 17025:2017  
standards for the scope of testing.




**CALA**  
Testing  
Accreditation No. 1005043

Laura Martin  
Laboratory Analyst

Ashlee McGiffin  
Data Review

End of Report

**Appendix B:  
Sample locations**

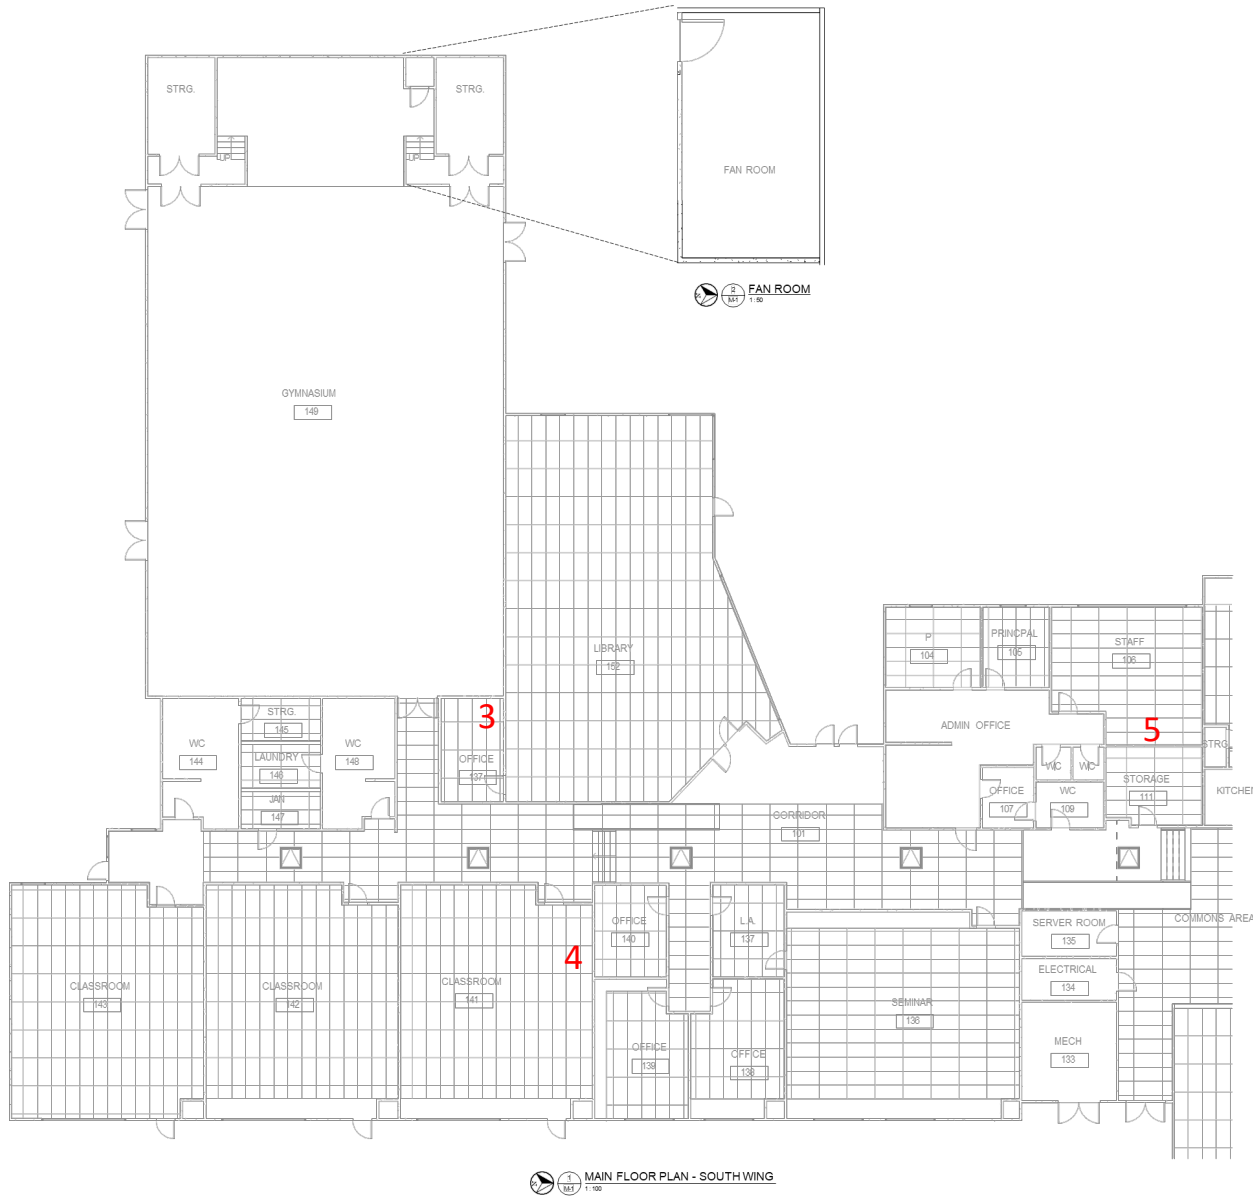

1 383 1:50 MAIN FLOOR PLAN - SOUTH WING

**LEGEND:**

XX – Water Sampling Location



Project No. 69843	Date of Issue November 14, 2025
----------------------	------------------------------------

Lead in Drinking Water  
Sample Locations


For: School District 70

Site: Eight Avenue Learning Centre  
2941 8<sup>th</sup> Avenue

Not to Scale	 Island EHS <small>Water &amp; Environmental Health &amp; Safety Ltd.</small>
--------------	---

**LEGEND:**

**XX** – Water Sampling Location

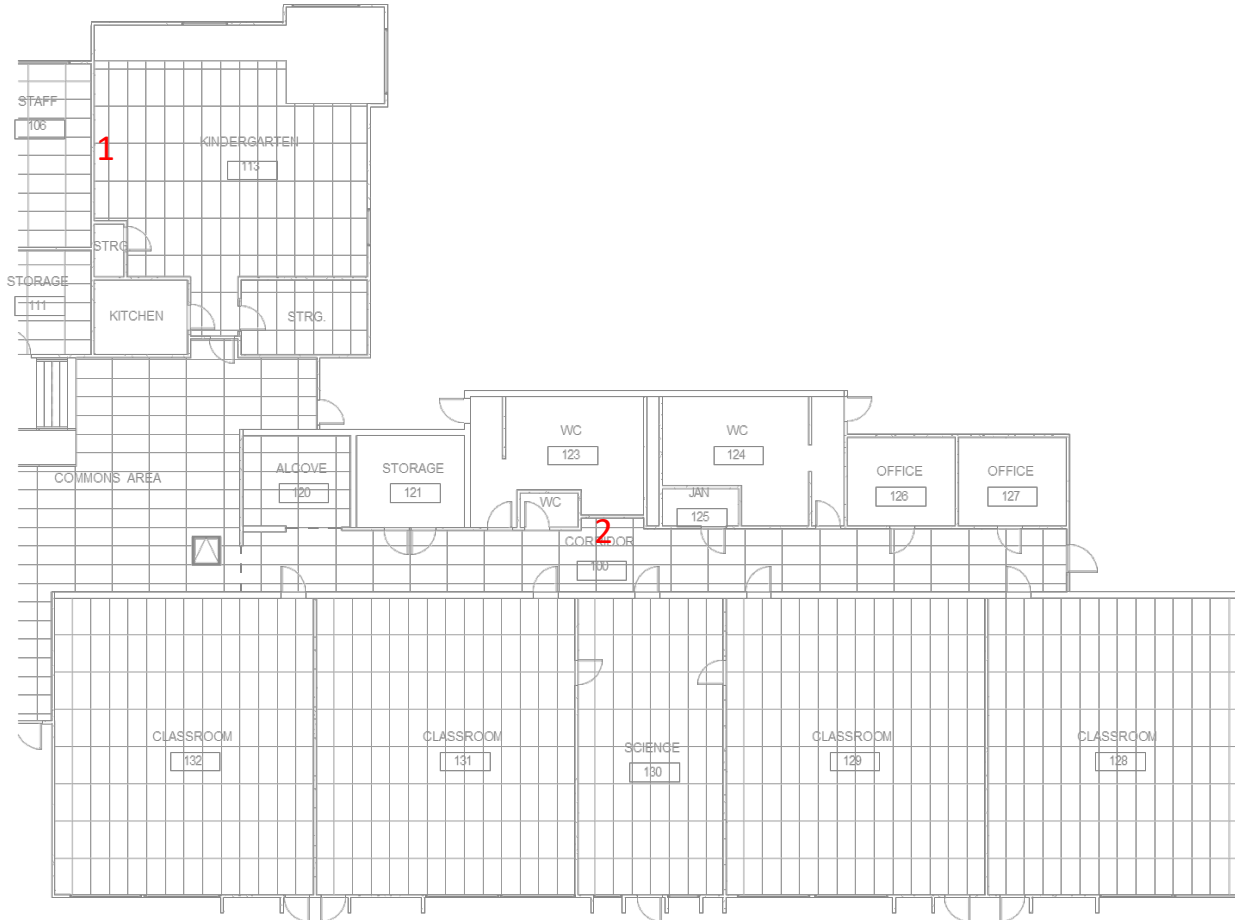

Project No.  
69843

Date of Issue  
November 14, 2025

Lead in Drinking Water  
Sample Locations

For: School District 70

Site: Eight Avenue Learning Centre  
2941 8<sup>th</sup> Avenue

Not to Scale

